


PLAN VIEW

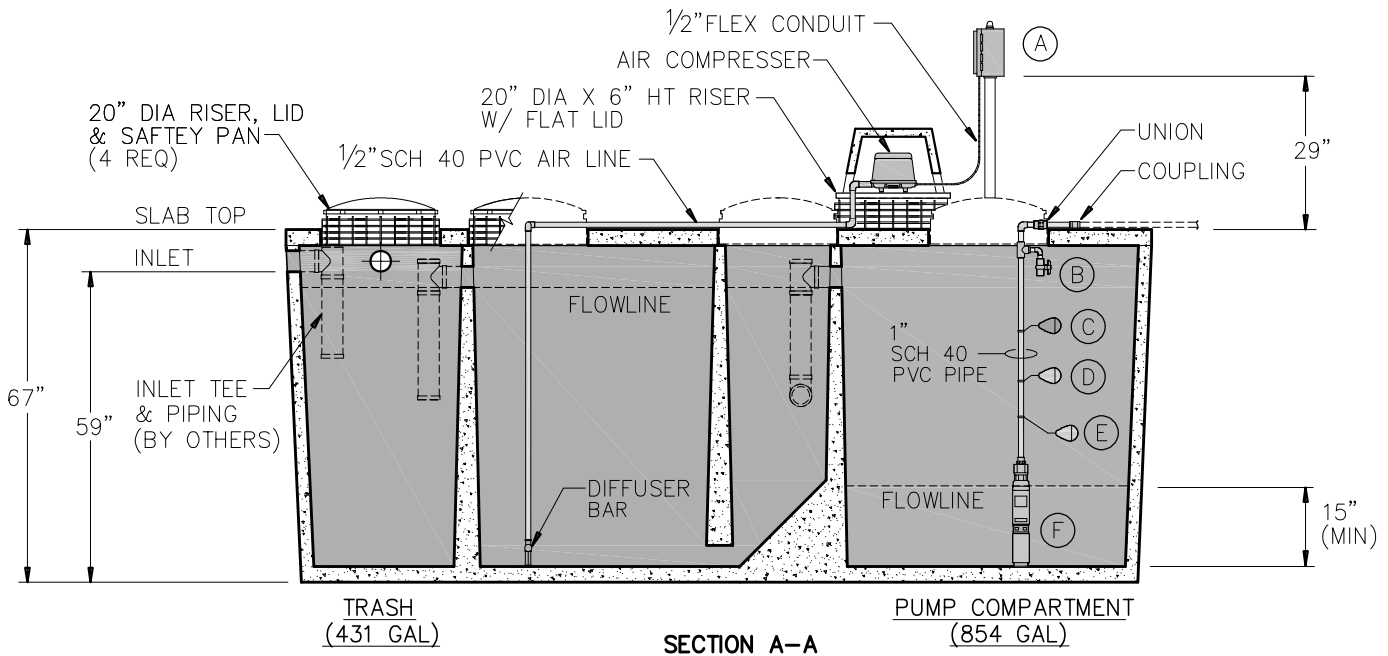

SECTION A-A

GENERAL NOTES:

- DESIGN SHALL MEET OR EXCEED ASTM C-1227 SPECIFICATIONS
- 4000 PSI CONCRETE AT 28 DAYS
- ASTM A615, GRADE 60 REINFORCING
- TREATMENT CAPACITY: 800 GPD
- BOD LOADING: 2.60 LBS PER DAY

EQUIPMENT:

- TABLET OR LIQUID CHLORINATOR AVAILABLE
- ADDITIONAL RISERS AVAILABLE TO BRING ACCESS TO GRADE (NOT INCLUDED)

EQUIPMENT:

- (A) CONTROL PANEL W/ TIMER FOR NIGHT SPRAY APPLICATION (OPTIONAL DRIP DOSING PANEL AVAILABLE)
- (B) RELIEF VALVE
- (C) HIGH WATER ALARM FLOAT
- (D) PUMP OVERRIDE FLOAT
- (E) PUMP CONTROL FLOAT
- (F) 20 GPM 1/2 HIGH HEAD EFFLUENT PUMP

WEIGHT:

• 16,700 LBS

MINIMUM EXCAVATION DIMENSIONS:

- WIDTH - 76"
- LENGTH - 176"

BURIAL DEPTH:

• MAXIMUM BURIAL DEPTH TO BE 40" FROM SLAB TOP TO GRADE

* SEE FLOAT CONFIGURATION DRAWING FOR FLOAT SET-UP



9235 Main Street #1
P.O. Box 507
Needville, Texas, 77461
1-888-331-5871

"Providing Concrete Environmental Solutions"

NUWATER 800 GPD
ALL-IN-ONE
AEROBIC TREATMENT UNIT
MODEL B-800 (ASSEMBLED)

NC-008-011

Scale: N.T.S.
* All Dimensions subject to allowable specification tolerances.

Date: 09/23/19

Rev Date: 10/27/22

Approved By: _____ Date: _____